Medium Static Pressure Duct

1 Specifications 2

2 Dimensions 6

3 Unit Placement 8

4 Piping Diagram 9

5 Wiring Diagrams 10

6 Fan Performance 12

7 Capacity Tables 16

8 Electrical Characteristics 26

9 Sound Levels 27

1 Specifications

MI2-22T2DHN1 / MI2-28T2DHN1 / MI2-36T2DHN1

Table 1.1: MI2-22(28, 36)T2DHN1 specifications

Model name			MI2-22T2DHN1	MI2-28T2DHN1	MI2-36T2DHN1
Power supply			1-phase, 220-240V, 50/60Hz		
Cooling[1]	Capacity	kW	2.2	2.8	3.6
		kBut/h	7.5	9.6	12.3
	Input	W	40	40	45
Heating[2]	Capacity	kW	2.6	3.2	4.0
		kBut/h	8.2	10.9	13.6
	Input	W	40	40	45
Fan motor	Model		ZKSP-30-8-3L	ZKSP-30-8-3L	ZKSP-30-8-3L
	Type		DC		
	Brand		Nidec/Welling/Yongan		
	Speed (H/M/L)	r/min	1010/936/863/790/740/690/640		1070/1004/937/870/830/790/750
Coil	Number of rows		2	2	2
	Tube pitch × row pitch	mm	21×13.37	21×13.37	21×13.37
	Fin spacing	mm	1.5	1.5	1.5
	Fin type		Hydrophilic aluminum		
	Tube OD and type	mm	Φ7 Inner groove		
	Dimensions (L×H ×W)	mm	515×147×26.74	515×147×26.74	515×147×26.74
	Number of circuits		3	4	4
Airflow rate[3]		m^3/h	520/480/440/400/360/330/300		580/540/500/460/430/400/370
External static pressure[4]		Pa	10 (0~50)		
Sound pressure level[5]		dB(A)	32/31/29/28/26/25/23		33/32/31/30/28/27/25
Unit	Net dimensions[6] (W×H×D)	mm	780x210x500		
	Packed dimensions (W×H×D)	mm	870×285×525		
	Net/Gross weight	kg	18/21		
Refrigerant type			R410A		
Throttle		Type	Electronic expansion valve		
		Model	D20MISZ-1R(L)		
Design pressure (H/L)		MPa	4.4/2.6		
Pipe connections	Liquid/Gas pipe	mm	Φ6.35/Φ12.7		
	Drain pipe	mm	OD Φ25		

Notes:

1. Indoor temperature 27°C DB, 19°C WB; outdoor temperature 35°C DB; equivalent refrigerant piping length 7.5m with zero level difference.
2. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
3. Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
4. Stable operation external static pressure range. (Note: setting external static pressure outside the unit's optimal static pressure range may lead to higher noise levels and lower airflow rate. For the optimal external static pressure range refer to the unit's installation manual.)
5. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 1.4m below the unit in a semi-anechoic chamber.
6. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.

MI2-45T2DHN1 / MI2-56T2DHN1 / MI2-71T2DHN1

Table 1.2: MI2-45(56, 71)T2DHN1 specifications

Model name			MI2-45T2DHN1	MI2-56T2DHN1	MI2-71T2DHN1
Power supply			1-phase, 220-240V, 50/60Hz		
Cooling[1]	Capacity	kW	4.5	5.6	7.1
		kBut/h	15.4	19.1	24.2
	Input	W	92	92	98
Heating[2]	Capacity	kW	5	6.3	8
		kBut/h	17.1	21.5	27.3
	Input	W	92	92	98
Fan motor	Model		ZKSP-30-8-3L	ZKSP-30-8-3L	ZKSP-60-8-2
	Type		DC		
	Brand		Nidec/Welling/Yongan		
	Speed (H/M/L)	r/min	1080/1027/974/920/ 827/734/640	1090/1044/997/950/ 900/850/800	1070/1024/977/930/ 877/824/770
Coil	Number of rows		2	2	2
	Tube pitch × row pitch	mm	21×13.37	21×13.37	21×13.37
	Fin spacing	mm	1.3	1.3	1.3
	Fin type		Hydrophilic aluminum		
	Tube OD and type	mm	Φ7 Inner groove		
	Dimensions (L×H ×W)	mm	735×147×26.74	735×147×26.74	952×147×26.74
	Number of circuits		6	6	6
Airflow rate[3]		m^3/h	800/740/680/620/ 540/480/400	830/760/720/680/ 640/600/560	1000/960/900/840/ 780/720/680
External static pressure[4]		Pa	10 (0~50)		
Sound pressure level[5]		dB(A)	36/34/32/31/29/27/25	36/34/33/32/30/29/28	37/35/33/32/30/29/28
Unit	Net dimensions[6] (W×H×D)	mm	1000x210x500		1220x210x500
	Packed dimensions (W×H×D)	mm	1115x285x525		1335x285x525
	Net/Gross weight	kg	21.5/25		27.5/31.5
Refrigerant type			R410A		
Throttle		Type	Electronic expansion valve		
		Model	D20MISZ-1R(L)		
Design pressure (H/L)		MPa	4.4/2.6		
Pipe connections	Liquid/Gas pipe	mm	Φ6.35/ Φ12.7	Φ9.53/Φ15.9	
	Drain pipe	mm	OD Φ25		

Notes:

1. Indoor temperature 27°C DB, 19°C WB; outdoor temperature 35°C DB; equivalent refrigerant piping length 7.5m with zero level difference.
2. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
3. Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
4. Stable operation external static pressure range. (Note: setting external static pressure outside the unit's optimal static pressure range may lead to higher noise levels and lower airflow rate. For the optimal external static pressure range refer to the unit's installation manual.)
5. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 1.4m below the unit in a semi-anechoic chamber.
6. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.

MI2-80T2DHN1 / MI2-90T2DHN1

Table 1.3: MI2-80(90)T2DHN1 specifications

Model name			MI2-80T2DHN1	MI2-90T2DHN1
Power supply			1-phase, 220-240V, 50/60Hz	
Cooling[1]	Capacity	kW	8	9
		kBut/h	27.3	30.7
	Input	W	110	120
Heating[2]	Capacity	kW	9	10
		kBut/h	30.7	34.1
	Input	W	110	120
Fan motor	Model		ZKFP-150-8-1	ZKFP-150-8-1
	Type		DC	
	Brand		Nidec/Welling/Match-Well	
	Speed (H/M/L)	r/min	800/757/714/670/627/584/540	800/757/714/670/627/584/540
Coil	Number of rows		4	4
	Tube pitch × row pitch	mm	21×13.37	21×13.37
	Fin spacing	mm	1.5	1.5
	Fin type		Hydrophilic aluminum	
	Tube OD and type	mm	Φ7 Inner groove	
	Dimensions (L×H ×W)	mm	955×336×58	955×336×58
	Number of circuits		5	8
Airflow rate[3]		m^3/h	1260/1180/1100/1020/940/860/780	1260/1180/1100/1020/940/860/780
External static pressure[4]		Pa	20 (10~100)	
Sound pressure level[5]		dB(A)	37/35/34/33/31/29/28	37/35/34/33/31/29/28
Unit	Net dimensions[6] (W×H×D)	mm	1230×270×775	
	Packed dimensions (W×H×D)	mm	1355×350×795	
	Net/Gross weight	kg	36.5/44.5	37/45
Refrigerant type			R410A	
Throttle		Type	Electronic expansion valve	
		Model	D20MISZ-1R(L)	
Design pressure (H/L)		MPa	4.4/2.6	
Pipe connections	Liquid/Gas pipe	mm	Φ9.53/Φ15.9	Φ9.53/Φ15.9
	Drain pipe	mm	OD Φ25	

Notes:

1. Indoor temperature 27°C DB, 19°C WB; outdoor temperature 35°C DB; equivalent refrigerant piping length 7.5m with zero level difference.
2. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
3. Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
4. Stable operation external static pressure range. (Note: setting external static pressure outside the unit's optimal static pressure range may lead to higher noise levels and lower airflow rate. For the optimal external static pressure range refer to the unit's installation manual.)
5. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 1.4m below the unit in a semi-anechoic chamber.
6. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.

MI2-112T2DHN1 / MI2-140T2DHN1

Table 1.4: MI2-112(140)T2DHN1 specifications

Model name			MI2-112T2DHN1	MI2-140T2DHN1
Power supply			1-phase, 220-240V, 50/60Hz	
Cooling[1]	Capacity	kW	11.2	14
		kBut/h	38.2	47.8
	Input	W	200	250
Heating[2]	Capacity	kW	12.5	15.5
		kBut/h	42.7	52.9
	Input	W	200	250
Fan motor	Model		ZKFP-150-8-1	ZKFP-240-8-1
	Type		DC	
	Brand		Nidec/Welling/Match-Well	
	Speed (H/M/L)	r/min	920/884/847/810/770/730/690	1060/1010/960/910/860/810/760
Coil	Number of rows		4	4
	Tube pitch × row pitch	mm	21×13.37	21×13.37
	Fin spacing	mm	1.5	1.5
	Fin type		Hydrophilic aluminum	
	Tube OD and type	mm	Φ7 Inner groove	
	Dimensions (L×H ×W)	mm	955×336×58	1030×378×58
	Number of circuits		8	8
Airflow rate[3]		m^3/h	1500/1430/1360/1290/1210/1140/1080	1960/1860/1760/1660/1560/1460/1360
External static pressure[4]		Pa	20 (10~100)	40 (30~150)
Sound pressure level[5]		dB(A)	39/38/38/37/35/34/33	41/39/38/37/36/35/33
Unit	Net dimensions[6] (W×H×D)	mm	1230×270×775	1290x300x865
	Packed dimensions (W×H×D)	mm	1355×350×795	1400x375x925
	Net/Gross weight	kg	37/45	46.5/55.5
Refrigerant type			R410A	
Throttle		Type	Electronic expansion valve	
		Model	D20MISZ-1R(L)	
Design pressure (H/L)		MPa	4.4/2.6	
Pipe connections	Liquid/Gas pipe	mm	Φ9.53/Φ15.9	Φ9.53/Φ15.9
	Drain pipe	mm	OD Φ25	

Notes:

1. Indoor temperature 27°C DB, 19°C WB; outdoor temperature 35°C DB; equivalent refrigerant piping length 7.5m with zero level difference.
2. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
3. Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
4. Stable operation external static pressure range. (Note: setting external static pressure outside the unit's optimal static pressure range may lead to higher noise levels and lower airflow rate. For the optimal external static pressure range refer to the unit's installation manual.)
5. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 1.4m below the unit in a semi-anechoic chamber.
6. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.

2 Dimensions

2.1 Unit Dimensions

Figure 2.1: Medium Static Pressure Duct dimensions (unit: mm)

Outline dimension and air outlet opening size

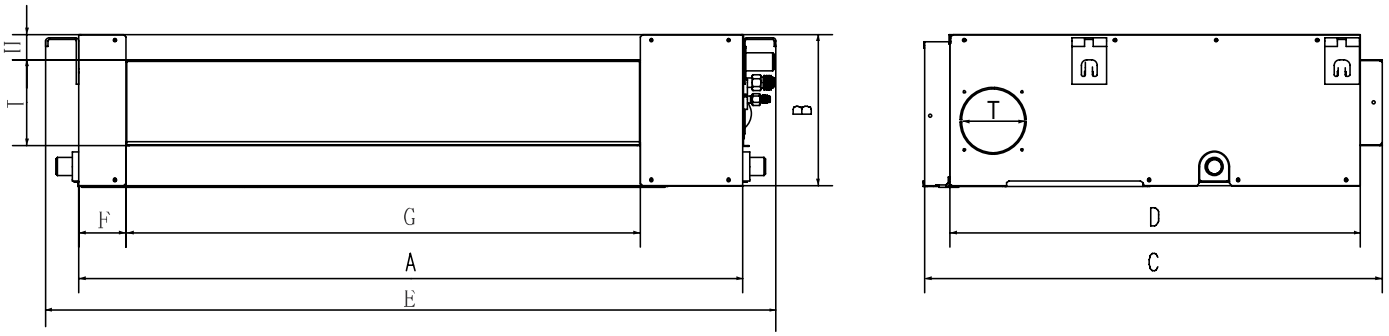

Air return opening size

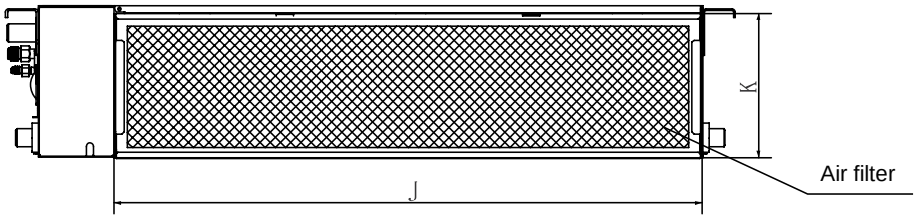

Position size of descensional ventilation opening

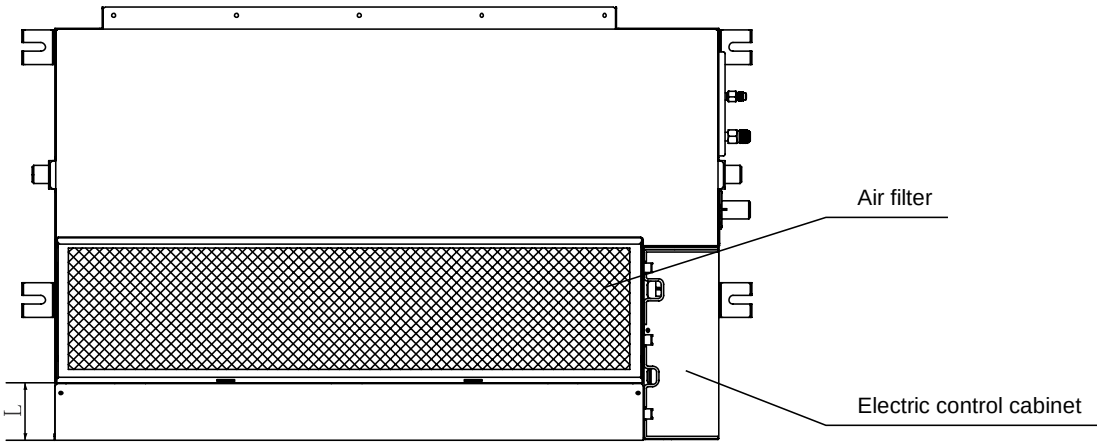

Size of mounted lug

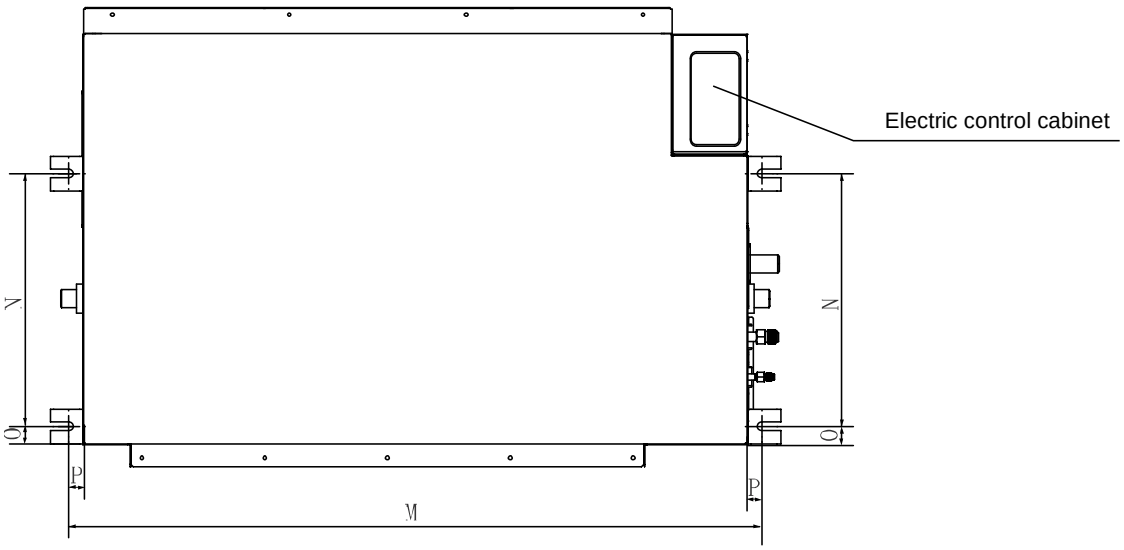

Table 2.1: Medium Static Pressure Duct dimensions

Model names	Dimension (mm)							
	A	B	C	D	E	F	G	H
MI2-22T2DHN1 - MI2-36T2DHN1	700	210	500	450	780	45	512	17
MI2-45T2DHN1 - MI2-56T2DHN1	920	210	500	450	1000	45	732	17
MI2-71T2DHN1	1140	210	500	450	1220	45	950	17
MI2-80T2DHN1 - MI2-112T2DHN1	1140	270	775	710	1230	65	933	35
MI2-140T2DHN1	1200	300	865	800	1290	85	969	40
Model names	**Dimension (mm)**							
	I	J	K	L	M	N	O	P
MI2-22T2DHN1 - MI2-36T2DHN1	145	570	180	-	740	350	35	20
MI2-45T2DHN1 - MI2-56T2DHN1	145	790	180	-	960	350	35	20
MI2-71T2DHN1	145	1010	180	-	1180	350	35	20
MI2-80T2DHN1 - MI2-112T2DHN1	179	1035	260	20	1180	490	26	20
MI2-140T2DHN1	204	1094	288	45	1240	500	26	20

Table 2.2: Medium Static Pressure Duct piping connections

Model names	Gas pipe (mm)	Liquid pipe (mm)
MI2-22T2DHN1 - MI2-45T2DHN1	Φ12.7	Φ6.35
MI2-56T2DHN1 - MI2-140T2DHN1	Φ15.9	Φ9.53

3 Unit Placement

3.1 Placement Considerations

Unit placement should take account of the following considerations:

- Units should not be installed in the following locations:
  - Where exposure to direct radiation from a high-temperature heat source or to interference from a source of electromagnetic radiation may occur.
  - Where dust or dirt may affect heat exchangers.
  - Where exposure to oil or to corrosive or harmful gases, such as acidic or alkaline gases, may occur.
  - Where exposure to salinity may occur, such as seaside locations.
  - Where highly flammable materials are present.
  - Where exposure to oily air may occur, such as a kitchen.
  - Where exposure to very high humidity may occur, such as a laundry.
- Units should be installed in positions where:
  - The ceiling is horizontal and is able to bear the unit's weight.
  - There are no obstructions that could impede the airflow into and out of the unit.
  - The airflow out of the unit can reach throughout the room.
  - There is sufficient space for access during installation, servicing and maintenance.
  - The refrigerant piping and drain piping can be easily connected to the refrigerant piping and drain piping systems.
  - Short-circuit ventilation (where outlet air returns quickly to a unit's air inlet) will not occur.

3.2 Space Requirements

Figure 3.1: Medium Static Pressure Duct space requirements (unit: mm)

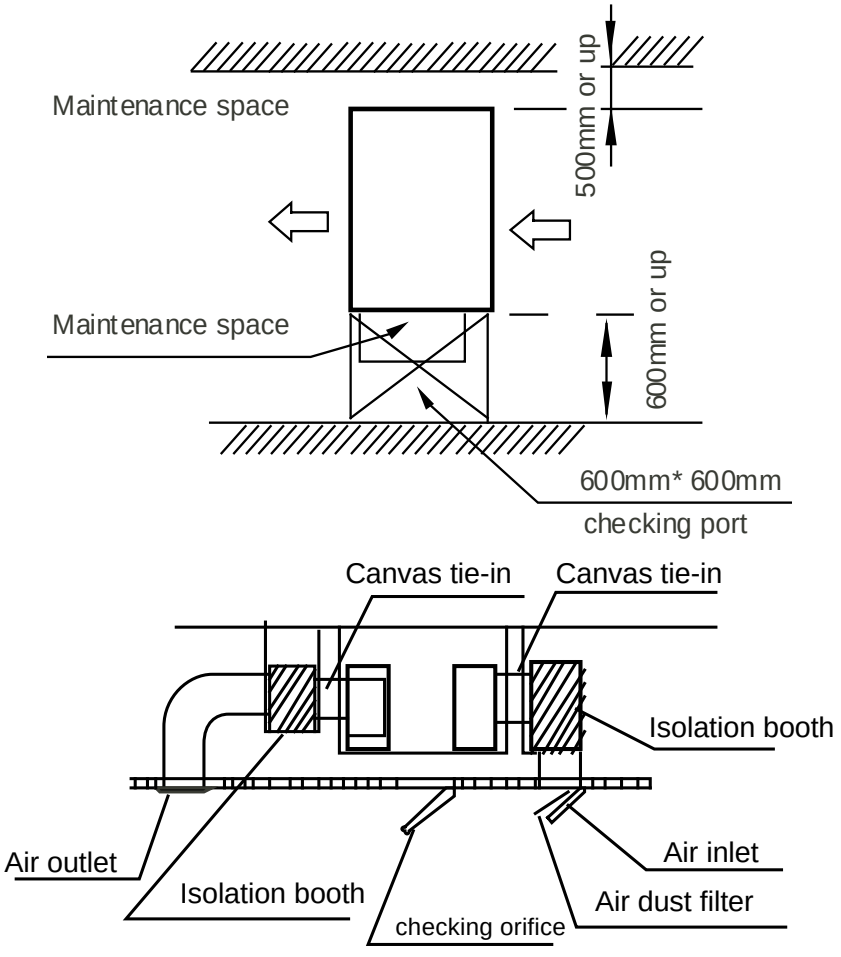

4 Piping Diagram

Figure 4.1: Medium Static Pressure Duct piping diagram

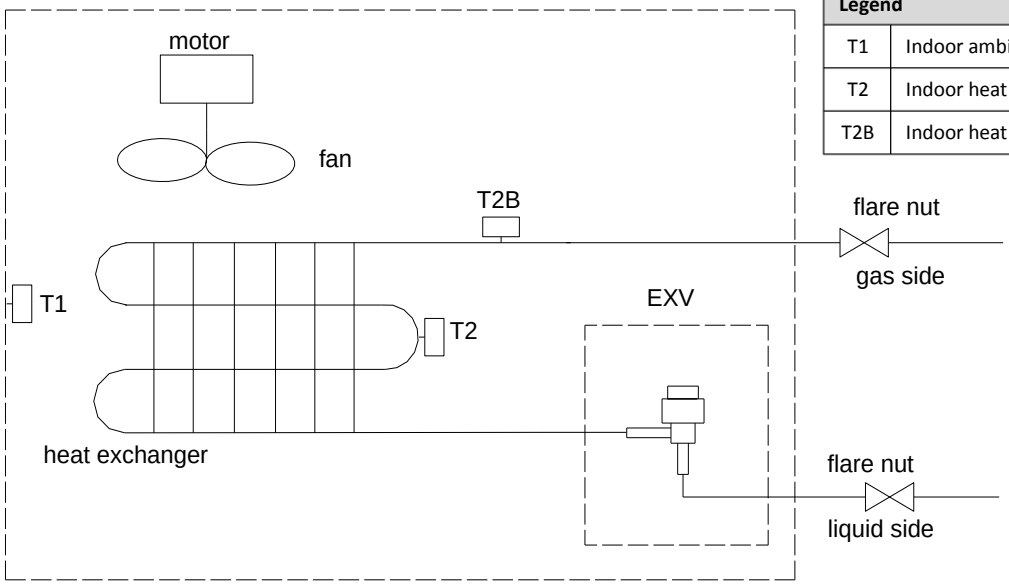

Legend	
T1	Indoor ambient temperature sensor
T2	Indoor heat exchanger mid-point temperature sensor
T2B	Indoor heat exchanger outlet temperature sensor

5 Wiring Diagrams

Figure 5.1: Medium Static Pressure Duct wiring diagram

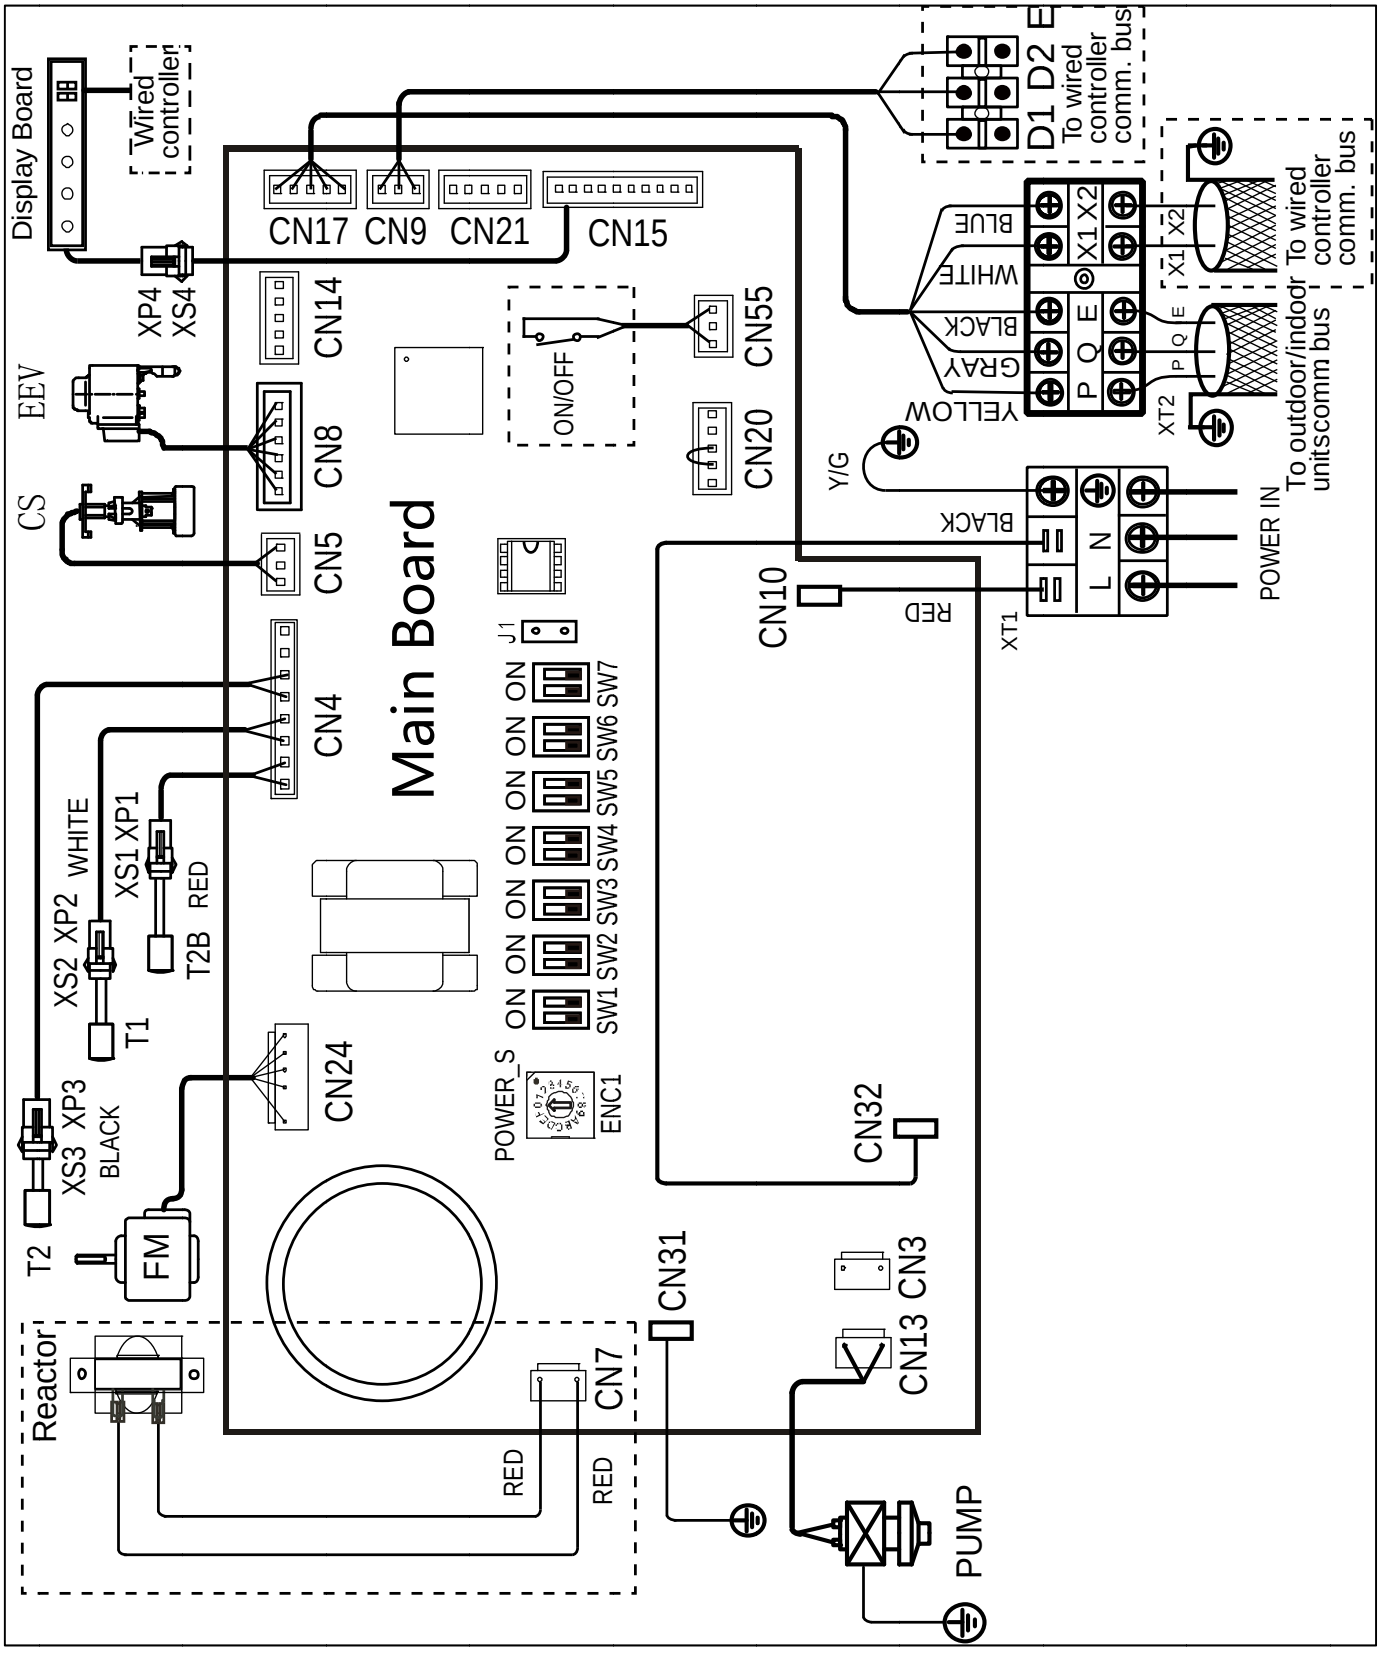

Notes for installers and service engineers

Caution

- All installation, servicing and maintenance must be carried out by competent and suitably qualified, certified and accredited professionals and in accordance with all applicable legislation.
- Units should be grounded in accordance with all applicable legislation. Metal and other conductive components should be insulated in accordance with all applicable legislation.
- Power supply wiring should be securely fastened at the power supply terminals – loose power supply wiring would represent a fire risk.
- After installation, servicing or maintenance, the electric control box cover should be closed. Failing to close the electric control box cover risks fire or electric shock.
- Switch ENC1 (indoor unit capacity setting) is factory-set and its setting should normally not be changed. The only circumstances in which a switch ENC1 might need to be set in the field is when replacing a main PCB. When replacing a main PCB, ensure that the capacity setting on switch ENC1 on the new PCB is consistent with the unit capacity given on the unit's nameplate.

6 Fan Performance

Figure 6.1: MI2-22(28)T2DHN1 fan performance

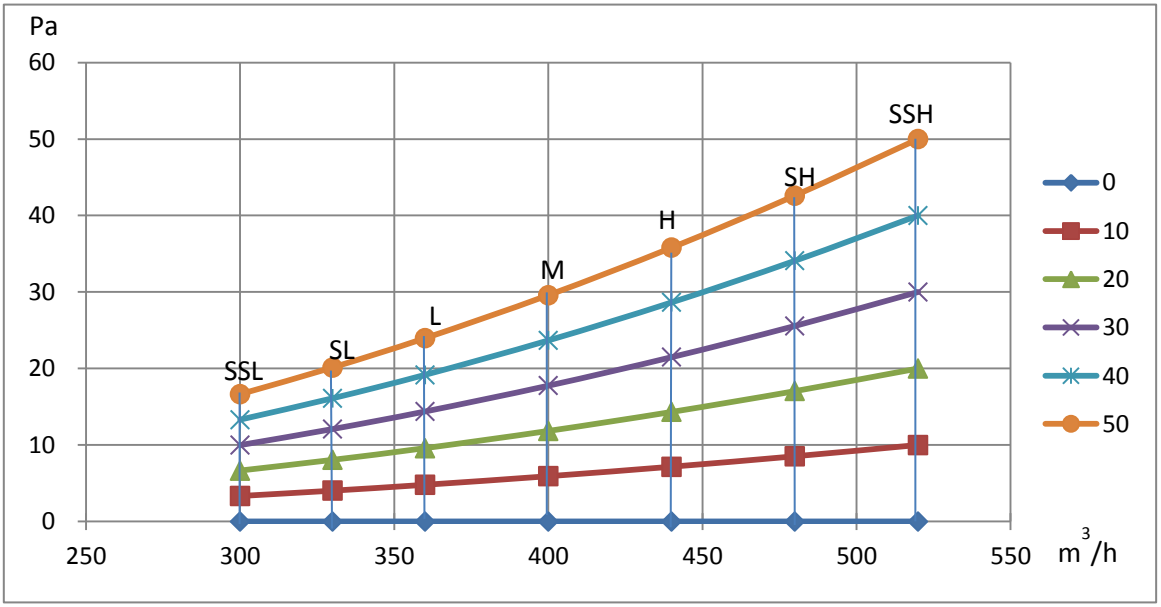

Figure 6.2: MI2-36T2DHN1 fan performance

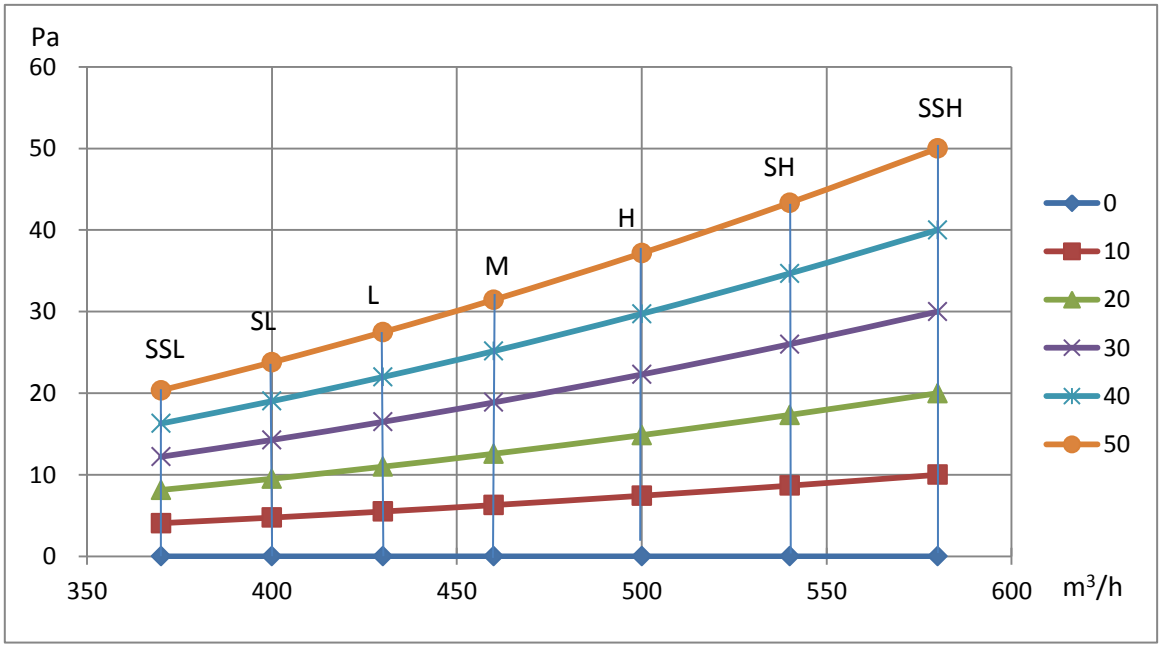

\

Figure 6.3: MI2-45T2DHN1 fan performance

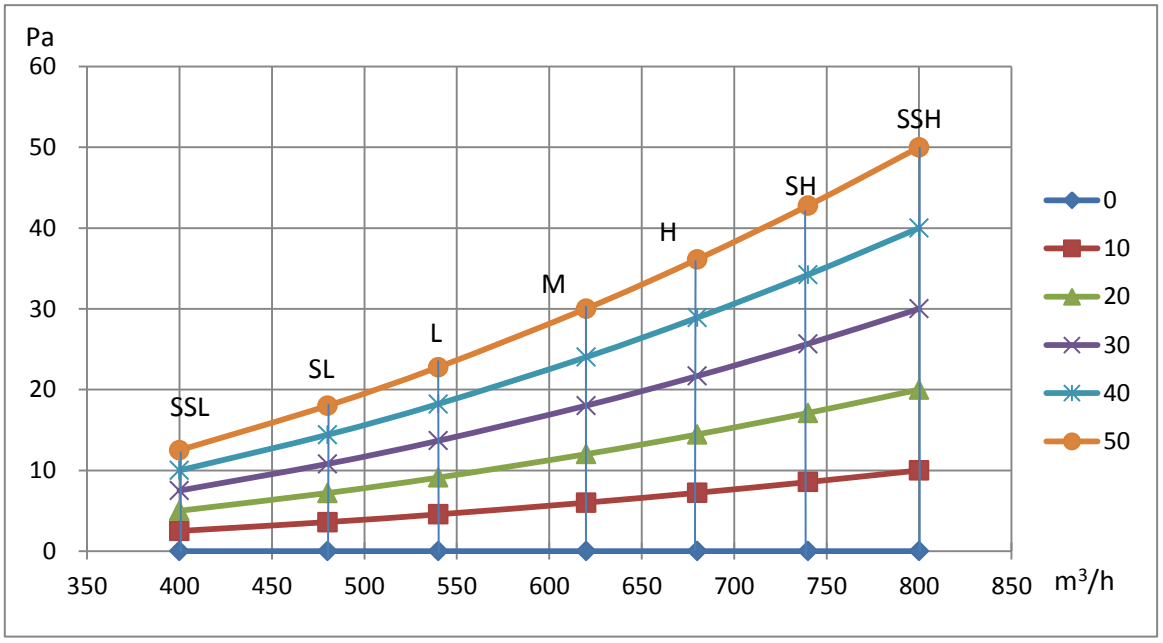

Figure 6.4: MI2-56T2DHN1 fan performance

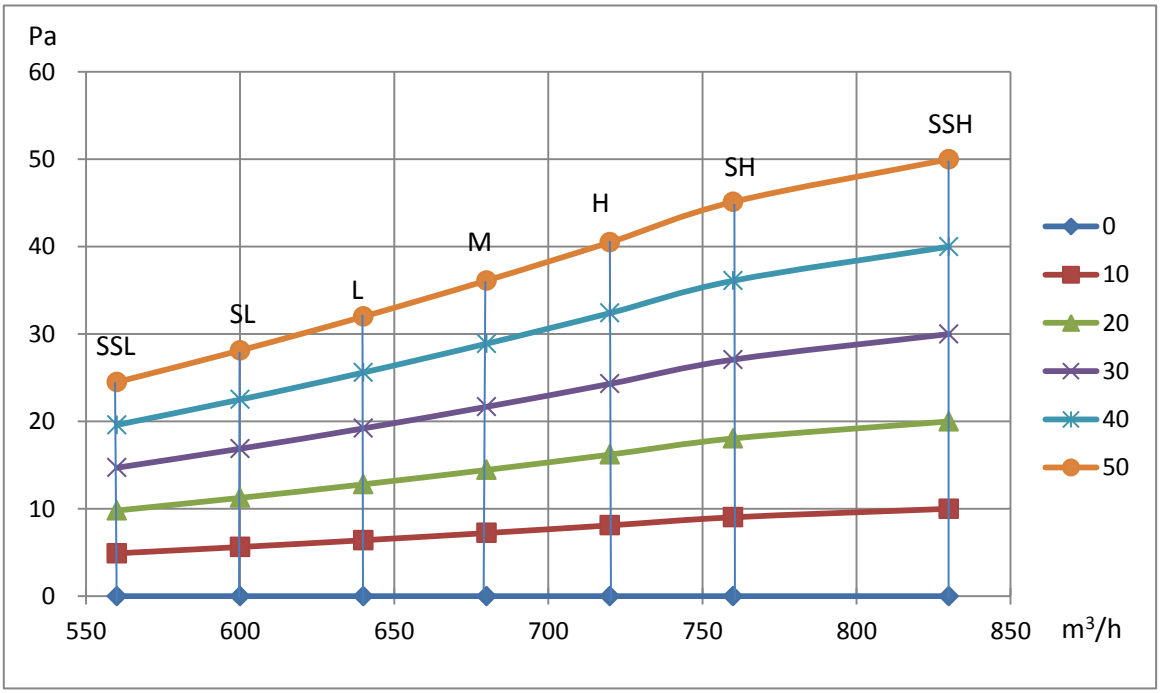

Figure 6.5: MI2-71T2DHN1 fan performance

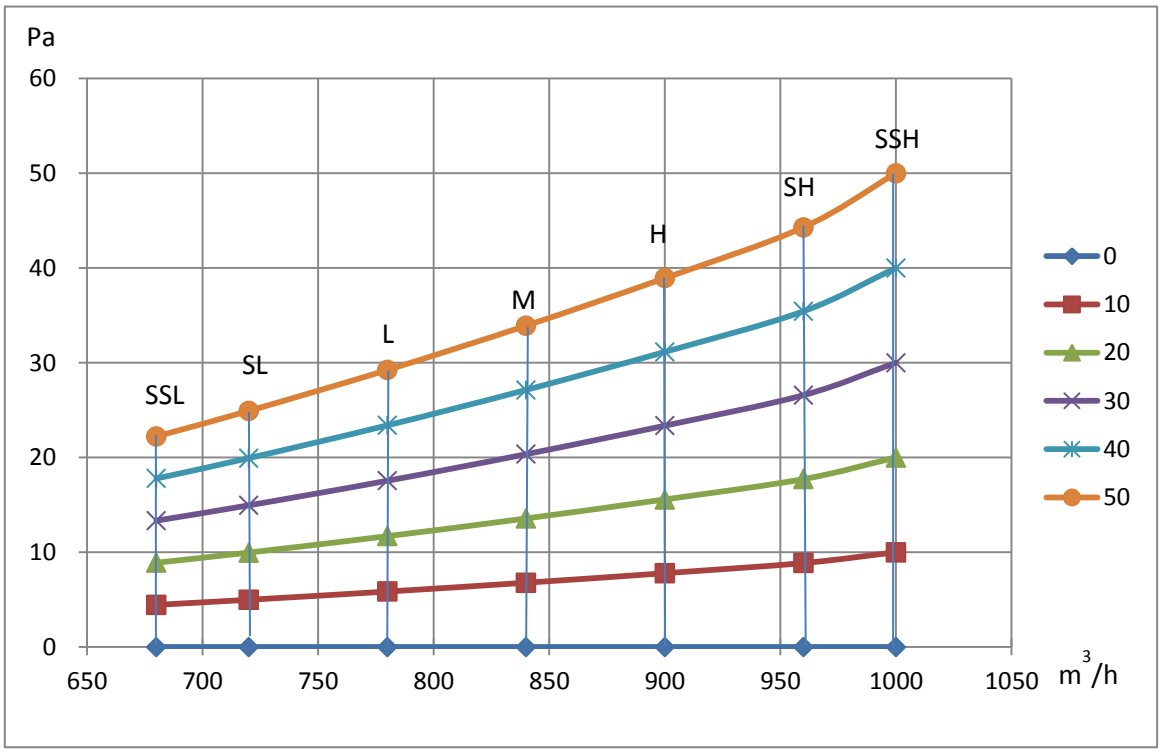

Figure 6.6: MI2-80(90)T2DHN1 fan performance

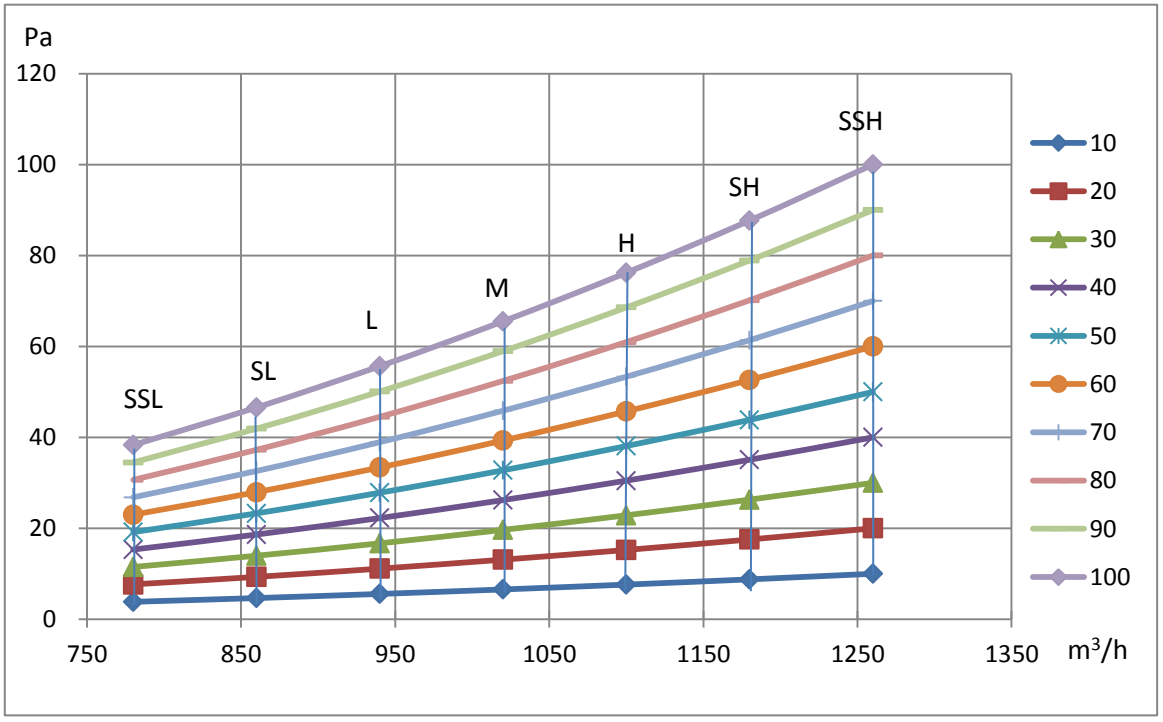

Figure 6.7: MI2-112T2DHN1 fan performance

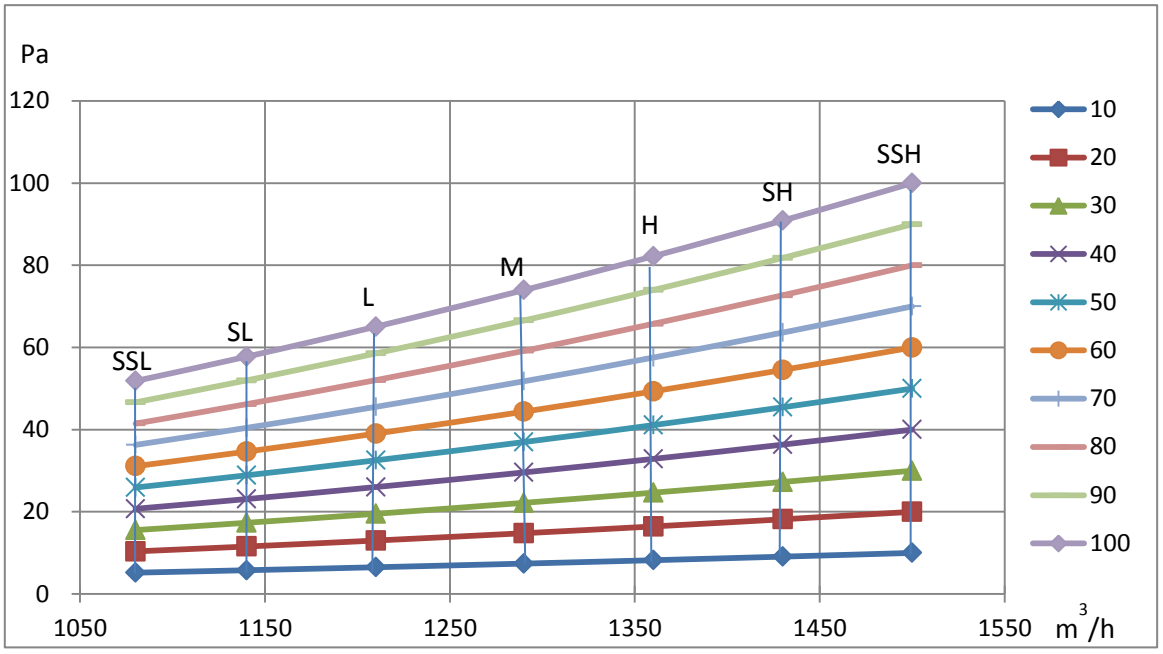

Figure 6.8: MI2-140T2DHN1 fan performance

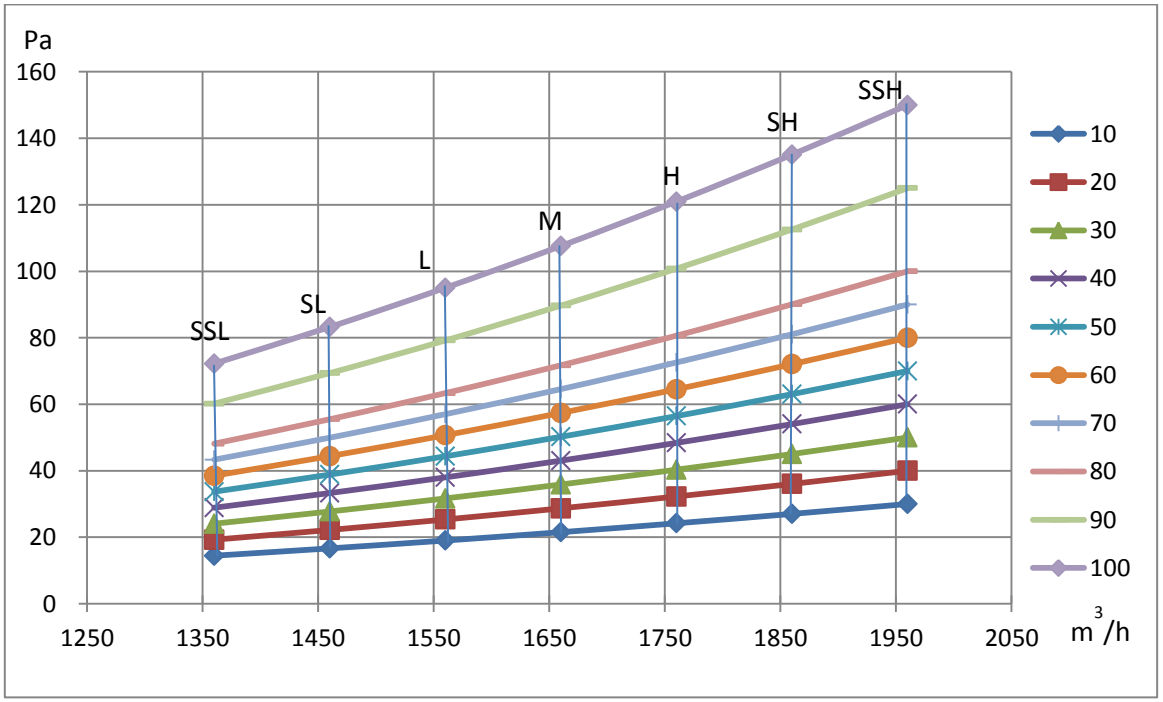

7 Capacity Tables

7.1 Cooling Capacity Table

Table 7.1: Medium Static Pressure Duct cooling capacity

Capacity (kW)	Outdoor air temperature (°C DB)	Indoor air temperature (°C WB/DB)													
		14/20		16/23		18/26		19/27		20/28		22/30		24/32	
		TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
2.2	10.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.6	1.7	2.9	1.7
	12.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.6	1.7	2.8	1.6
	14.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.6	1.7	2.8	1.6
	16.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.6	1.7	2.8	1.6
	18.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.6	1.7	2.8	1.6
	20.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.6	1.7	2.7	1.5
	21.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.6	1.7	2.7	1.5
	23.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.5	1.6	2.7	1.5
	25.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.5	1.6	2.6	1.5
	27.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.5	1.6	2.6	1.5
	29.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.4	1.5	2.5	1.5
	31.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.4	1.5	2.5	1.5
	33.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.4	1.5	2.4	1.5
	35.0	1.5	1.4	1.8	1.5	2.1	1.6	**2.2**	1.6	2.3	1.7	2.3	1.5	2.4	1.5
	37.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.3	1.7	2.3	1.5	2.3	1.5
	39.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.2	1.6	2.3	1.5	2.3	1.5
	42.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.2	1.6	2.3	1.5	2.3	1.5
	44.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.2	1.6	2.3	1.5	2.3	1.5
	46.0	1.5	1.4	1.8	1.5	2.1	1.6	2.2	1.6	2.2	1.6	2.3	1.5	2.3	1.5
2.8	10.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.3	2.2	3.7	2.2
	12.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.3	2.2	3.6	2.1
	14.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.3	2.2	3.6	2.1
	16.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.3	2.2	3.5	2.1
	18.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.3	2.2	3.5	2.1
	20.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.3	2.2	3.4	2.1
	21.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.3	2.2	3.4	2.1
	23.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.3	2.1	3.4	2.1
	25.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.2	2.1	3.3	2.0
	27.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.2	2.1	3.3	2.0
	29.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.1	2.0	3.2	1.9
	31.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.1	2.0	3.2	1.9
	33.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	3.0	2.1	3.1	2.0	3.1	1.9
	35.0	1.9	1.7	2.3	1.9	2.6	2.1	**2.8**	2.1	2.9	2.0	3.0	2.0	3.1	1.9
	37.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	2.9	2.0	3.0	2.0	3.0	1.8
	39.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	2.9	2.0	3.0	2.1	3.0	1.9
	42.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	2.9	2.0	3.0	2.1	3.0	1.9
	44.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	2.9	2.0	3.0	2.1	3.0	1.9
	46.0	1.9	1.7	2.3	1.9	2.6	2.1	2.8	2.1	2.9	2.0	3.0	2.1	3.0	1.9

Abbreviations:
TC: Total capacity
SC: Sensible capacity

Notes:
1. Shaded cells indicate rating condition.

Table continued on next page …

Table 7.1: Medium Static Pressure Duct cooling capacity (continued)

Capacity (kW)	Outdoor air temperature (°C DB)	Indoor air temperature (°C WB/DB)													
		14/20		16/23		18/26		19/27		20/28		22/30		24/32	
		TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
3.6	10.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.3	2.6	4.7	2.7
	12.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.3	2.6	4.7	2.7
	14.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.3	2.6	4.6	2.6
	16.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.3	2.6	4.5	2.6
	18.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.3	2.6	4.5	2.6
	20.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.3	2.6	4.4	2.5
	21.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.3	2.6	4.4	2.5
	23.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.1	2.5	4.3	2.4
	25.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.1	2.5	4.2	2.4
	27.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.0	2.4	4.2	2.4
	29.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.0	2.4	4.1	2.4
	31.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.2	2.8	4.1	2.4
	33.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.8	2.7	4.2	2.8	3.9	2.3
	35.0	2.5	2.1	2.9	2.3	3.4	2.5	**3.6**	2.6	3.8	2.7	4.2	2.8	3.9	2.3
	37.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.7	2.6	3.8	2.5	3.9	2.3
	39.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.7	2.6	3.8	2.5	3.8	2.3
	42.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.7	2.6	3.8	2.5	3.8	2.3
	44.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.7	2.6	3.8	2.5	3.8	2.3
	46.0	2.5	2.1	2.9	2.3	3.4	2.5	3.6	2.6	3.7	2.6	3.8	2.5	3.8	2.3
4.5	10.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.3	3.7	5.9	3.3
	12.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.3	3.7	5.9	3.3
	14.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.3	3.7	5.8	3.3
	16.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.3	3.7	5.6	3.2
	18.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.3	3.7	5.7	3.3
	20.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.3	3.7	5.7	3.3
	21.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.3	3.7	5.6	3.3
	23.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.3	3.7	5.5	3.2
	25.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.2	3.3	5.4	3.2
	27.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.1	3.2	5.2	3.0
	29.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.1	3.2	5.2	3.0
	31.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	5.0	3.1	5.1	2.9
	33.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	4.9	3.1	5.1	2.9
	35.0	3.1	2.6	3.7	2.8	4.2	3.1	**4.5**	3.2	4.8	3.2	4.8	3.0	5.0	2.9
	37.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.8	3.2	4.8	3.1	4.9	2.8
	39.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.6	3.1	4.7	3.1	4.8	2.8
	42.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.6	3.1	4.7	3.1	4.8	2.8
	44.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.6	3.1	4.7	3.1	4.8	2.8
	46.0	3.1	2.6	3.7	2.8	4.2	3.1	4.5	3.2	4.6	3.1	4.7	3.1	4.8	2.8

Abbreviations:
TC: Total capacity
SC: Sensible capacity

Notes:
1. Shaded cells indicate rating condition.

Table continued on next page …

Table 7.1: Medium Static Pressure Duct cooling capacity (continued)

Capacity (kW)	Outdoor air temperature (°C DB)	Indoor air temperature (°C WB/DB)													
		14/20		16/23		18/26		19/27		20/28		22/30		24/32	
		TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
5.6	10.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.6	3.9	7.3	3.9
	12.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.6	3.9	7.2	3.8
	14.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.6	3.9	7.1	3.8
	16.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.6	3.9	7.0	3.7
	18.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.6	3.9	6.8	3.7
	20.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.6	3.9	6.7	3.6
	21.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.6	3.9	6.6	3.6
	23.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.6	3.9	6.6	3.5
	25.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.6	3.9	6.5	3.5
	27.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.4	3.8	6.4	3.5
	29.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.3	3.8	6.4	3.6
	31.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.2	3.7	6.2	3.4
	33.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	6.2	3.7	6.2	3.4
	35.0	3.9	3.0	4.6	3.3	5.3	3.6	**5.6**	3.7	5.9	3.8	6.0	3.6	6.0	3.4
	37.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.9	3.8	5.9	3.5	6.0	3.4
	39.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.7	3.7	5.8	3.5	6.0	3.4
	42.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.7	3.7	5.8	3.5	6.0	3.4
	44.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.7	3.7	5.8	3.5	6.0	3.4
	46.0	3.9	3.0	4.6	3.3	5.3	3.6	5.6	3.7	5.7	3.7	5.8	3.5	6.0	3.4
7.1	10.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.4	4.9	9.2	5.0
	12.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.4	4.9	9.1	4.9
	14.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.4	4.9	9.0	4.9
	16.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.4	4.9	8.9	4.8
	18.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.4	4.9	8.7	4.7
	20.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.4	4.9	8.5	4.6
	21.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.4	4.9	8.4	4.5
	23.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.4	4.9	8.3	4.5
	25.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.4	4.9	8.2	4.4
	27.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.1	4.7	8.2	4.5
	29.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	8.0	4.7	8.1	4.5
	31.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	7.9	4.6	7.8	4.3
	33.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.5	4.8	7.8	4.6	7.8	4.3
	35.0	4.9	3.9	5.8	4.3	6.7	4.7	**7.1**	4.9	7.5	4.8	7.6	4.5	7.7	4.2
	37.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.4	4.8	7.5	4.5	7.6	4.3
	39.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.2	4.7	7.4	4.4	7.6	4.3
	42.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.2	4.7	7.4	4.4	7.6	4.3
	44.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.2	4.7	7.4	4.4	7.6	4.3
	46.0	4.9	3.9	5.8	4.3	6.7	4.7	7.1	4.9	7.2	4.7	7.4	4.4	7.6	4.3

Abbreviations:
TC: Total capacity
SC: Sensible capacity

Notes:
1. Shaded cells indicate rating condition.

Table continued on next page …

Table 7.1: Medium Static Pressure Duct cooling capacity (continued)

Capacity (kW)	Outdoor air temperature (°C DB)	Indoor air temperature (°C WB/DB)													
		14/20		16/23		18/26		19/27		20/28		22/30		24/32	
		TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
8.0	10.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	10.4	5.6
	12.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	10.2	5.5
	14.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	10.2	5.5
	16.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	10.0	5.4
	18.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	9.8	5.3
	20.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	9.6	5.2
	21.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	9.4	5.1
	23.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	9.4	5.1
	25.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	9.3	5.0
	27.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.1	5.3	9.2	5.1
	29.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.5	9.0	5.3	9.1	5.0
	31.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.5	8.9	5.2	8.8	4.8
	33.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.5	8.8	5.2	8.8	4.8
	35.0	5.5	4.4	6.6	4.9	7.5	5.3	**8.0**	5.5	8.4	5.5	8.6	5.1	8.6	4.8
	37.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.3	5.4	8.4	5.0	8.6	4.9
	39.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.1	5.3	8.3	5.0	8.6	4.9
	42.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.1	5.3	8.3	5.0	8.6	4.9
	44.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.1	5.3	8.3	5.0	8.6	4.9
	46.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.1	5.3	8.3	5.0	8.6	4.9
9.0	10.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.6	6.6	11.7	6.6
	12.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.6	6.6	11.5	6.5
	14.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.6	6.6	11.4	6.4
	16.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.6	6.6	11.3	6.3
	18.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.6	6.6	11.0	6.3
	20.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.6	6.6	10.8	6.2
	21.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.6	6.6	10.6	6.1
	23.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.6	6.6	10.5	6.0
	25.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.6	6.6	10.4	6.0
	27.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.3	6.4	10.4	5.9
	29.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.1	6.2	10.3	5.8
	31.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	10.0	6.2	9.9	5.7
	33.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.6	6.5	9.9	6.1	9.9	5.7
	35.0	6.2	5.3	7.3	5.8	8.4	6.3	**9.0**	6.4	9.5	6.5	9.6	6.0	9.7	5.7
	37.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.3	6.3	9.5	5.9	9.6	5.8
	39.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.2	6.2	9.4	5.8	9.6	5.8
	42.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.2	6.2	9.4	5.8	9.6	5.8
	44.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.2	6.2	9.4	5.8	9.6	5.8
	46.0	6.2	5.3	7.3	5.8	8.4	6.3	9.0	6.4	9.2	6.2	9.4	5.8	9.6	5.8

Abbreviations:
TC: Total capacity
SC: Sensible capacity

Notes:
1. Shaded cells indicate rating condition.

Table continued on next page …

Table 7.1: Medium Static Pressure Duct cooling capacity (continued)

Capacity (kW)	Outdoor air temperature (°C DB)	Indoor air temperature (°C WB/DB)													
		14/20		16/23		18/26		19/27		20/28		22/30		24/32	
		TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
11.2	10.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	13.3	8.3	15.5	9.0
	12.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	13.3	8.3	14.4	8.4
	14.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	13.3	8.3	14.2	8.2
	16.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	13.3	8.3	14.1	8.2
	18.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	13.3	8.3	14.0	8.1
	20.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	13.3	8.3	13.9	8.1
	21.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	13.3	8.3	13.8	8.0
	23.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	13.1	8.1	13.7	7.9
	25.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	13.0	8.1	13.6	7.9
	27.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	12.9	8.0	13.4	7.8
	29.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	12.8	7.9	13.3	7.9
	31.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	12.7	7.8	12.8	7.5
	33.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.9	8.1	12.5	7.8	12.5	7.4
	35.0	7.7	6.4	9.1	7.1	10.5	7.7	**11.2**	7.8	11.8	8.0	12.4	7.7	12.3	7.3
	37.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.6	7.9	12.3	7.6	12.1	7.1
	39.0	7.7	6.4	9.1	7.1	10.5	7.7	11.2	7.8	11.4	7.8	12.2	7.6	11.9	7.1
	42.0	7.7	6.6	9.1	7.2	10.4	7.8	11.2	8.0	11.4	7.8	11.6	7.2	12.0	7.2
	44.0	7.7	6.6	9.1	7.2	10.4	7.8	11.2	8.0	11.4	7.8	11.6	7.2	12.0	7.2
	46.0	7.7	6.6	9.1	7.2	10.4	7.8	11.2	8.0	11.4	7.8	11.6	7.2	12.0	7.2
14.0	10.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.7	10.2	18.2	10.2
	12.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.7	10.2	17.9	10.0
	14.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.7	10.2	17.8	10.0
	16.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.7	10.2	17.5	9.8
	18.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.7	10.2	17.1	9.6
	20.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.7	10.2	16.8	9.4
	21.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.7	10.2	16.5	9.3
	23.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.4	10.2	16.4	9.2
	25.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.2	10.1	16.2	9.1
	27.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.1	10.0	16.1	9.2
	29.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	16.0	9.9	16.0	9.1
	31.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	15.8	9.8	15.4	8.8
	33.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.8	9.8	15.7	9.7	15.4	8.8
	35.0	9.7	7.8	11.3	8.6	13.2	9.6	**14.0**	9.8	14.7	9.7	15.1	9.4	15.1	8.8
	37.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.6	9.6	15.1	9.4	15.0	8.7
	39.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.3	9.4	14.6	9.2	15.0	8.8
	42.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.3	9.4	14.6	9.2	15.0	8.8
	44.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.3	9.4	14.6	9.2	15.0	8.8
	46.0	9.7	7.8	11.3	8.6	13.2	9.6	14.0	9.8	14.3	9.4	14.6	9.2	15.0	8.8

Abbreviations:
TC: Total capacity
SC: Sensible capacity

Notes:
1. Shaded cells indicate rating condition.

7.2 Heating Capacity Table

Table 7.2: Medium Static Pressure Duct heating capacity

Capacity (kW)	Outdoor air temperature (°C)		Indoor air temperature (°C DB)					
			16	18	20	21	22	24
			TC	TC	TC	TC	TC	TC
	WB	DB	kW	kW	kW	kW	kW	kW
2.2	-20	-19.8	1.46	1.46	1.46	1.46	1.46	1.46
	-19	-18.8	1.56	1.56	1.56	1.56	1.56	1.56
	-17	-16.7	1.64	1.64	1.64	1.64	1.64	1.64
	-15	-14.7	1.69	1.69	1.69	1.69	1.69	1.69
	-13.00	-12.60	1.79	1.79	1.79	1.79	1.79	1.79
	-11.00	-10.50	1.82	1.85	1.85	1.85	1.85	1.85
	-10.00	-9.50	1.90	1.90	1.90	1.90	1.90	1.90
	-9.10	-8.50	1.95	1.95	1.95	1.95	1.95	1.95
	-7.60	-7.00	1.98	1.98	1.98	1.98	1.98	1.98
	-5.60	-5.00	2.05	2.05	2.05	2.05	2.05	2.05
	-3.70	-3.00	2.16	2.16	2.16	2.16	2.16	2.16
	-0.70	0.00	2.31	2.31	2.31	2.31	2.31	2.18
	2.20	3.00	2.44	2.44	2.44	2.44	2.39	2.18
	4.10	5.00	2.52	2.52	2.52	2.52	2.39	2.18
	6.00	7.00	2.60	2.60	**2.60**	2.52	2.39	2.18
	7.90	9.00	2.68	2.68	2.60	2.52	2.39	2.18
	9.80	11.00	2.76	2.76	2.60	2.52	2.39	2.18
	11.80	13.00	2.86	2.81	2.60	2.52	2.39	2.18
	13.70	15.00	2.94	2.81	2.60	2.52	2.39	2.18
2.8	-20	-19.8	1.79	1.79	1.79	1.79	1.79	1.79
	-19	-18.8	1.92	1.92	1.92	1.92	1.92	1.92
	-17	-16.7	2.02	2.02	2.02	2.02	2.02	2.02
	-15	-14.7	2.02	2.02	2.02	2.02	2.02	2.02
	-13.00	-12.60	2.14	2.14	2.14	2.14	2.14	2.14
	-11.00	-10.50	2.24	2.24	2.24	2.24	2.24	2.24
	-10.00	-9.50	2.34	2.34	2.34	2.34	2.34	2.34
	-9.10	-8.50	2.40	2.40	2.40	2.40	2.40	2.40
	-7.60	-7.00	2.43	2.43	2.43	2.43	2.43	2.43
	-5.60	-5.00	2.53	2.53	2.53	2.53	2.53	2.53
	-3.70	-3.00	2.66	2.66	2.66	2.66	2.66	2.66
	-0.70	0.00	2.85	2.85	2.85	2.85	2.85	2.69
	2.20	3.00	3.01	3.01	3.01	3.01	2.94	2.69
	4.10	5.00	3.10	3.10	3.10	3.10	2.94	2.69
	6.00	7.00	3.20	3.20	**3.20**	3.10	2.94	2.69
	7.90	9.00	3.30	3.30	3.20	3.10	2.94	2.69
	9.80	11.00	3.39	3.39	3.20	3.10	2.94	2.69
	11.80	13.00	3.52	3.46	3.20	3.10	2.94	2.69
	13.70	15.00	3.62	3.46	3.20	3.10	2.94	2.69

Abbreviations:
TC: Total capacity

Notes:
1. Shaded cells indicate rating condition.

Table continued on next page …

Table 7.2: Medium Static Pressure Duct heating capacity (continued)

Capacity (kW)	Outdoor air temperature (°C)		Indoor air temperature (°C DB)					
			16	18	20	21	22	24
			TC	TC	TC	TC	TC	TC
	WB	DB	kW	kW	kW	kW	kW	kW
3.6	-20	-19.8	2.24	2.24	2.24	2.24	2.24	2.24
	-19	-18.8	2.40	2.40	2.40	2.40	2.40	2.40
	-17	-16.7	2.52	2.52	2.52	2.52	2.52	2.52
	-15	-14.7	2.60	2.60	2.60	2.60	2.60	2.60
	-13.00	-12.60	2.68	2.68	2.68	2.68	2.68	2.68
	-11.00	-10.50	2.80	2.80	2.80	2.80	2.80	2.80
	-10.00	-9.50	2.92	2.92	2.92	2.92	2.92	2.92
	-9.10	-8.50	3.00	3.00	3.00	3.00	3.00	3.00
	-7.60	-7.00	3.04	3.04	3.04	3.04	3.04	3.04
	-5.60	-5.00	3.16	3.16	3.16	3.16	3.16	3.16
	-3.70	-3.00	3.32	3.32	3.32	3.32	3.32	3.32
	-0.70	0.00	3.56	3.56	3.56	3.56	3.56	3.36
	2.20	3.00	3.76	3.76	3.76	3.76	3.68	3.36
	4.10	5.00	3.88	3.88	3.88	3.88	3.68	3.36
	6.00	7.00	4.00	4.00	**4.00**	3.88	3.68	3.36
	7.90	9.00	4.12	4.12	4.00	3.88	3.68	3.36
	9.80	11.00	4.24	4.24	4.00	3.88	3.68	3.36
	11.80	13.00	4.40	4.32	4.00	3.88	3.68	3.36
	13.70	15.00	4.52	4.32	4.00	3.88	3.68	3.36
4.5	-20	-19.8	2.80	2.80	2.80	2.80	2.80	2.80
	-19	-18.8	3.00	3.00	3.00	3.00	3.00	3.00
	-17	-16.7	3.15	3.15	3.15	3.15	3.15	3.15
	-15	-14.7	3.25	3.25	3.25	3.25	3.25	3.25
	-13.00	-12.60	3.35	3.35	3.35	3.35	3.35	3.35
	-11.00	-10.50	3.50	3.50	3.50	3.50	3.50	3.50
	-10.00	-9.50	3.65	3.65	3.65	3.65	3.65	3.65
	-9.10	-8.50	3.75	3.75	3.75	3.75	3.75	3.75
	-7.60	-7.00	3.80	3.80	3.80	3.80	3.80	3.80
	-5.60	-5.00	3.95	3.95	3.95	3.95	3.95	3.95
	-3.70	-3.00	4.15	4.15	4.15	4.15	4.15	4.15
	-0.70	0.00	4.45	4.45	4.45	4.45	4.45	4.20
	2.20	3.00	4.70	4.70	4.70	4.70	4.60	4.20
	4.10	5.00	4.85	4.85	4.85	4.85	4.60	4.20
	6.00	7.00	5.00	5.00	**5.00**	4.85	4.60	4.20
	7.90	9.00	5.15	5.15	5.00	4.85	4.60	4.20
	9.80	11.00	5.30	5.30	5.00	4.85	4.60	4.20
	11.80	13.00	5.50	5.40	5.00	4.85	4.60	4.20
	13.70	15.00	5.65	5.40	5.00	4.85	4.60	4.20

Abbreviations:
TC: Total capacity

Notes:
1. Shaded cells indicate rating condition.

Table continued on next page …

Table 7.2: Medium Static Pressure Duct heating capacity (continued)

Capacity (kW)	Outdoor air temperature (°C)		Indoor air temperature (°C DB)					
			16	18	20	21	22	24
			TC	TC	TC	TC	TC	TC
	WB	DB	kW	kW	kW	kW	kW	kW
5.6	-20	-19.8	3.53	3.53	3.53	3.53	3.53	3.53
	-19	-18.8	3.78	3.78	3.78	3.78	3.78	3.78
	-17	-16.7	3.97	3.97	3.97	3.97	3.97	3.97
	-15	-14.7	4.10	4.10	4.10	4.10	4.10	4.10
	-13.00	-12.60	4.22	4.22	4.22	4.22	4.22	4.22
	-11.00	-10.50	4.41	4.41	4.41	4.41	4.41	4.41
	-10.00	-9.50	4.60	4.60	4.60	4.60	4.60	4.60
	-9.10	-8.50	4.73	4.73	4.73	4.73	4.73	4.73
	-7.60	-7.00	4.79	4.79	4.79	4.79	4.79	4.79
	-5.60	-5.00	4.98	4.98	4.98	4.98	4.98	4.98
	-3.70	-3.00	5.23	5.23	5.23	5.23	5.23	5.23
	-0.70	0.00	5.61	5.61	5.61	5.61	5.61	5.29
	2.20	3.00	5.92	5.92	5.92	5.92	5.8	5.29
	4.10	5.00	6.11	6.11	6.11	6.11	5.8	5.29
	6.00	7.00	6.30	6.30	**6.30**	6.11	5.8	5.29
	7.90	9.00	6.49	6.49	6.3	6.11	5.8	5.29
	9.80	11.00	6.68	6.68	6.3	6.11	5.8	5.29
	11.80	13.00	6.93	6.8	6.3	6.11	5.8	5.29
	13.70	15.00	7.12	6.8	6.3	6.11	5.8	5.29
7.1	-20	-19.8	4.48	4.48	4.48	4.48	4.48	4.48
	-19	-18.8	4.80	4.80	4.80	4.80	4.80	4.80
	-17	-16.7	5.04	5.04	5.04	5.04	5.04	5.04
	-15	-14.7	5.20	5.20	5.20	5.20	5.20	5.20
	-13.00	-12.60	5.36	5.36	5.36	5.36	5.36	5.36
	-11.00	-10.50	5.60	5.60	5.60	5.60	5.60	5.60
	-10.00	-9.50	5.84	5.84	5.84	5.84	5.84	5.84
	-9.10	-8.50	6.00	6.00	6.00	6.00	6.00	6.00
	-7.60	-7.00	6.08	6.08	6.08	6.08	6.08	6.08
	-5.60	-5.00	6.32	6.32	6.32	6.32	6.32	6.32
	-3.70	-3.00	6.64	6.64	6.64	6.64	6.64	6.64
	-0.70	0.00	7.12	7.12	7.12	7.12	7.12	6.72
	2.20	3.00	7.52	7.52	7.52	7.52	7.36	6.72
	4.10	5.00	7.76	7.76	7.76	7.76	7.36	6.72
	6.00	7.00	8.00	8.00	**8.00**	7.76	7.36	6.72
	7.90	9.00	8.24	8.24	8.00	7.76	7.36	6.72
	9.80	11.00	8.48	8.48	8.00	7.76	7.36	6.72
	11.80	13.00	8.8	8.64	8.00	7.76	7.36	6.72
	13.70	15.00	9.04	8.64	8.00	7.76	7.36	6.72

Abbreviations:
TC: Total capacity

Notes:
1. Shaded cells indicate rating condition.

Table continued on next page …

Table 7.2: Medium Static Pressure Duct heating capacity (continued)

Capacity (kW)	Outdoor air temperature (°C)		Indoor air temperature (°C DB)					
			16	18	20	21	22	24
			TC	TC	TC	TC	TC	TC
	WB	DB	kW	kW	kW	kW	kW	kW
8.0	-20	-19.8	5.04	5.04	5.04	5.04	5.04	5.04
	-19	-18.8	5.40	5.40	5.40	5.40	5.40	5.40
	-17	-16.7	5.67	5.67	5.67	5.67	5.67	5.67
	-15	-14.7	5.85	5.85	5.85	5.85	5.85	5.85
	-13.00	-12.60	6.03	6.03	6.03	6.03	6.03	6.03
	-11.00	-10.50	6.30	6.30	6.30	6.30	6.30	6.30
	-10.00	-9.50	6.57	6.57	6.57	6.57	6.57	6.57
	-9.10	-8.50	6.75	6.75	6.75	6.75	6.75	6.75
	-7.60	-7.00	6.84	6.84	6.84	6.84	6.84	6.84
	-5.60	-5.00	7.11	7.11	7.11	7.11	7.11	7.11
	-3.70	-3.00	7.47	7.47	7.47	7.47	7.47	7.47
	-0.70	0.00	8.01	8.01	8.01	8.01	8.01	7.56
	2.20	3.00	8.46	8.46	8.46	8.46	8.28	7.56
	4.10	5.00	8.73	8.73	8.73	8.73	8.28	7.56
	6.00	7.00	9.00	9.00	**9.00**	8.73	8.28	7.56
	7.90	9.00	9.27	9.27	9.00	8.73	8.28	7.56
	9.80	11.00	9.54	9.54	9.00	8.73	8.28	7.56
	11.80	13.00	9.9	9.72	9.00	8.73	8.28	7.56
	13.70	15.00	10.17	9.72	9.00	8.73	8.28	7.56
9.0	-20	-19.8	5.60	5.04	5.60	5.60	5.60	5.60
	-19	-18.8	6.00	5.40	6.00	6.00	6.00	6.00
	-17	-16.7	6.30	6.30	6.30	6.30	6.30	6.30
	-15	-14.7	6.50	6.50	6.50	6.50	6.50	6.50
	-13.00	-12.60	6.70	6.70	6.70	6.70	6.70	6.70
	-11.00	-10.50	7.00	7.00	7.00	7.00	7.00	7.00
	-10.00	-9.50	7.30	7.30	7.30	7.30	7.30	7.30
	-9.10	-8.50	7.50	7.50	7.50	7.50	7.50	7.50
	-7.60	-7.00	7.60	7.60	7.60	7.60	7.60	7.60
	-5.60	-5.00	7.90	7.90	7.90	7.90	7.90	7.90
	-3.70	-3.00	8.30	8.30	8.30	8.30	8.30	8.30
	-0.70	0.00	8.90	8.90	8.90	8.90	8.90	8.40
	2.20	3.00	9.40	9.40	9.40	9.40	9.20	8.40
	4.10	5.00	9.70	9.70	9.70	9.70	9.20	8.40
	6.00	7.00	10.0	10.0	**10.0**	9.70	9.20	8.40
	7.90	9.00	10.3	10.3	10.0	9.70	9.20	8.40
	9.80	11.00	10.6	10.6	10.0	9.70	9.20	8.40
	11.80	13.00	11.0	10.8	10.0	9.70	9.20	8.40
	13.70	15.00	11.3	10.8	10.0	9.70	9.20	8.40

Abbreviations:
TC: Total capacity

Notes:
1. Shaded cells indicate rating condition.

Table continued on next page …

Table 7.2: Medium Static Pressure Duct heating capacity (continued)

Capacity (kW)	Outdoor air temperature (°C)		Indoor air temperature (°C DB)					
			16	18	20	21	22	24
			TC	TC	TC	TC	TC	TC
	WB	DB	kW	kW	kW	kW	kW	kW
11.2	-20	-19.8	7.00	7.00	7.00	7.00	7.00	7.00
	-19	-18.8	7.50	7.50	7.50	7.50	7.50	7.50
	-17	-16.7	7.88	7.88	7.88	7.88	7.88	7.88
	-15	-14.7	8.13	8.13	8.13	8.13	8.13	8.13
	-13.00	-12.60	8.38	8.38	8.38	8.38	8.38	8.38
	-11.00	-10.50	8.75	8.75	8.75	8.75	8.75	8.75
	-10.00	-9.50	9.13	9.13	9.13	9.13	9.13	9.13
	-9.10	-8.50	9.38	9.38	9.38	9.38	9.38	9.38
	-7.60	-7.00	9.50	9.50	9.50	9.50	9.50	9.50
	-5.60	-5.00	9.88	9.88	9.88	9.88	9.88	9.88
	-3.70	-3.00	10.38	10.38	10.38	10.38	10.38	10.38
	-0.70	0.00	11.13	11.13	11.13	11.13	11.13	10.5
	2.20	3.00	11.75	11.75	11.75	11.75	11.5	10.5
	4.10	5.00	12.13	12.13	12.13	12.13	11.5	10.5
	6.00	7.00	12.5	12.5	**12.5**	12.13	11.5	10.5
	7.90	9.00	12.88	12.88	12.5	12.13	11.5	10.5
	9.80	11.00	13.25	13.25	12.5	12.13	11.5	10.5
	11.80	13.00	13.75	13.5	12.5	12.13	11.5	10.5
	13.70	15.00	14.13	13.5	12.5	12.13	11.5	10.5
14.0	-20	-19.8	8.68	8.68	8.68	8.68	8.68	8.68
	-19	-18.8	9.30	9.30	9.30	9.30	9.30	9.30
	-17	-16.7	9.77	9.77	9.77	9.77	9.77	9.77
	-15	-14.7	10.08	10.08	10.08	10.08	10.08	10.08
	-13.00	-12.60	10.4	10.4	10.4	10.4	10.4	10.4
	-11.00	-10.50	10.9	10.9	10.9	10.9	10.9	10.9
	-10.00	-9.50	11.3	11.3	11.3	11.3	11.3	11.3
	-9.10	-8.50	11.6	11.6	11.6	11.6	11.6	11.6
	-7.60	-7.00	11.8	11.8	11.8	11.8	11.8	11.8
	-5.60	-5.00	12.3	12.3	12.3	12.3	12.3	12.3
	-3.70	-3.00	12.9	12.9	12.9	12.9	12.9	12.9
	-0.70	0.00	13.8	13.8	13.8	13.8	13.8	13.0
	2.20	3.00	14.6	14.6	14.6	14.6	14.3	13.0
	4.10	5.00	15.0	15.0	15.0	15.0	14.3	13.0
	6.00	7.00	15.5	15.5	**15.5**	15.0	14.3	13.0
	7.90	9.00	16.0	16.0	15.5	15.0	14.3	13.0
	9.80	11.00	16.4	16.4	15.5	15.0	14.3	13.0
	11.80	13.00	17.1	16.7	15.5	15.0	14.3	13.0
	13.70	15.00	17.5	16.7	15.5	15.0	14.3	13.0

Abbreviations:
TC: Total capacity

Notes:
1. Shaded cells indicate rating condition.

8 Electrical Characteristics

Table 8.1: Medium Static Pressure Duct electrical characteristics

Model name	Power supply						Indoor fan motors	
	Hz	Volts	Min. volts	Max. volts	MCA	MFA	Rated motor output (kW)	FLA
MI2-22T2DHN1	50/60	220-240	198	264	0.74	15	0.03	0.59
MI2-28T2DHN1	50/60	220-240	198	264	0.74	15	0.03	0.59
MI2-36T2DHN1	50/60	220-240	198	264	0.77	15	0.03	0.62
MI2-45T2DHN1	50/60	220-240	198	264	1	15	0.03	0.80
MI2-56T2DHN1	50/60	220-240	198	264	1	15	0.03	0.80
MI2-71T2DHN1	50/60	220-240	198	264	1.1	15	0.06	0.88
MI2-80T2DHN1	50/60	220-240	198	264	1.3	15	0.15	1.04
MI2-90T2DHN1	50/60	220-240	198	264	1.3	15	0.15	1.04
MI2-112T2DHN1	50/60	220-240	198	264	1.5	15	0.15	1.20
MI2-140T2DHN1	50/60	220-240	198	264	2.6	15	0.24	2.08

Abbreviations:
MCA: Minimum Circuit Amps
MFA: Maximum Fuse Amps
FLA: Full Load Amps

9 Sound Levels

9.1 Overall

Table 9.1: Medium Static Pressure Duct sound pressure levels[1]

Model name	Sound pressure levels dB(A)						
	SSH	SH	H	M	L	SL	SSL
MI2-22T2DHN1	32	31	29	28	26	25	23
MI2-28T2DHN1	32	31	29	28	26	25	23
MI2-36T2DHN1	33	32	31	30	28	27	25
MI2-45T2DHN1	36	34	32	31	29	27	25
MI2-56T2DHN1	36	34	33	32	30	29	28
MI2-71T2DHN1	37	35	33	32	30	29	28
MI2-80T2DHN1	37	35	34	33	31	29	28
MI2-90T2DHN1	37	35	34	33	31	29	28
MI2-112T2DHN1	39	38	38	37	35	34	33
MI2-140T2DHN1	41	39	38	37	36	35	33

Notes:

1. Sound pressure levels are measured 1.4m below the unit in a semi-anechoic chamber. During in-situ operation, sound pressure levels may be higher as a result of ambient noise.

Figure 9.1: Medium Static Pressure Duct sound pressure level measurement

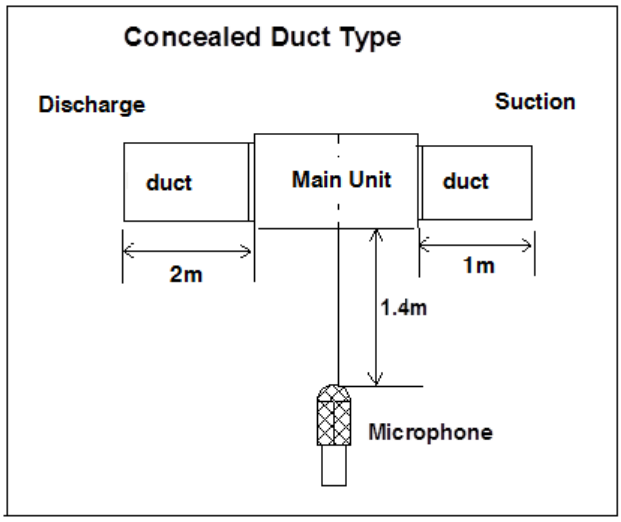

9.2 Octave Band Levels

Figure 9.2: MI2-22(28)T2DHN1 octave band levels

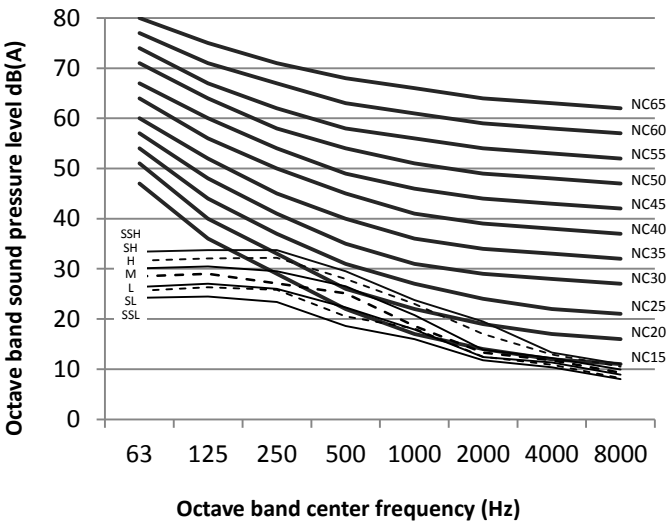

Figure 9.3: MI2-36T2DHN1 octave band levels

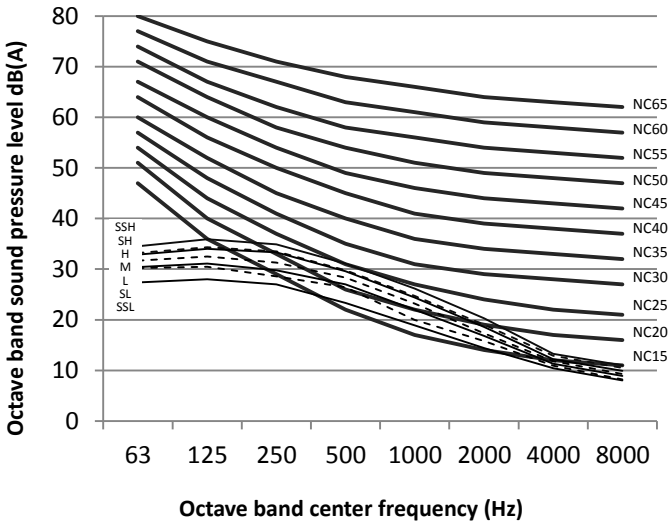

Figure 9.4: MI2-45T2DHN1 octave band levels

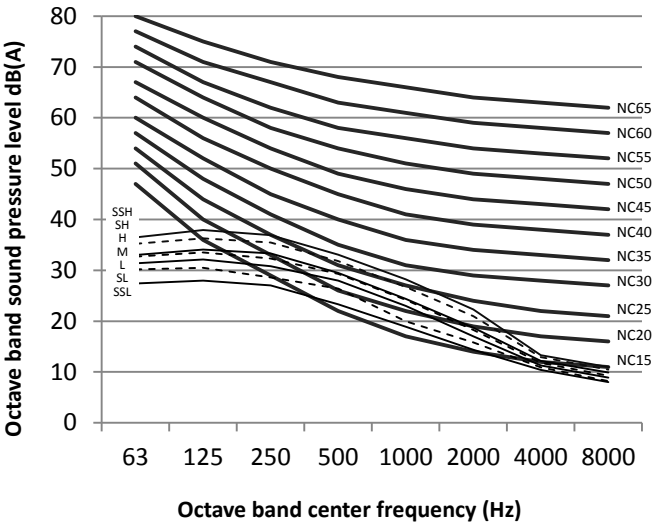

Figure 9.5: MI2-56T2DHN1 octave band levels

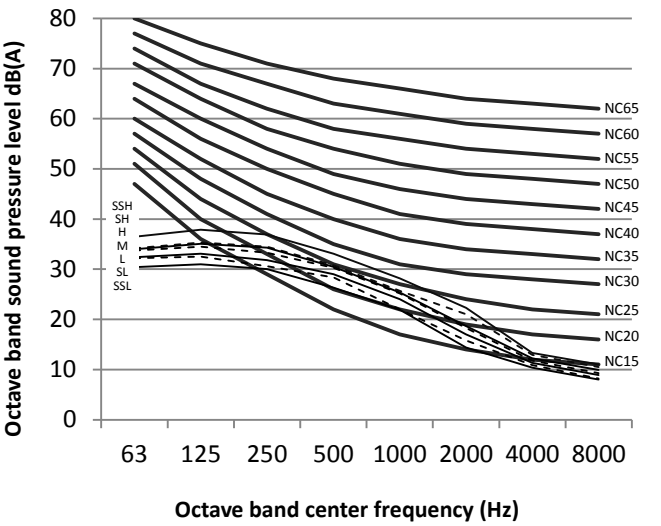

Figure 9.6: MI2-71T2DHN1 octave band levels

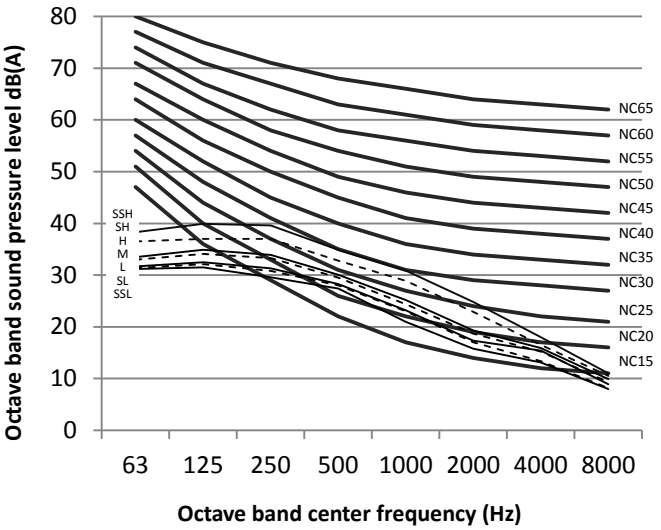

Figure 9.7: MI2-80(90)T2DHN1 octave band levels

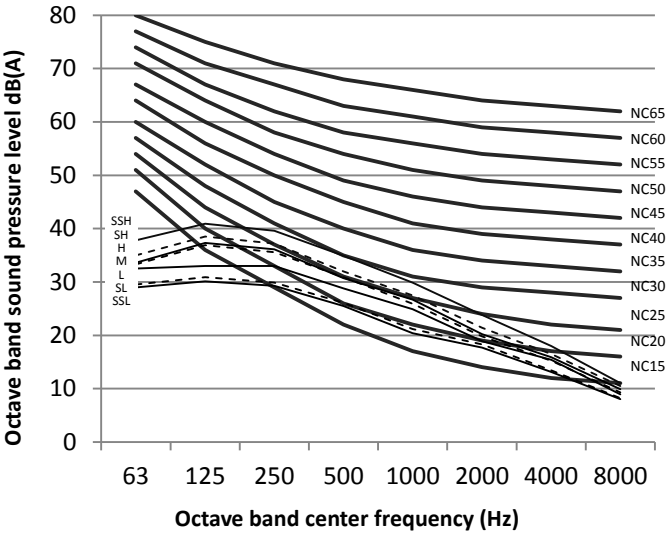

Figure 9.8: MI2-112T2DHN1 octave band levels

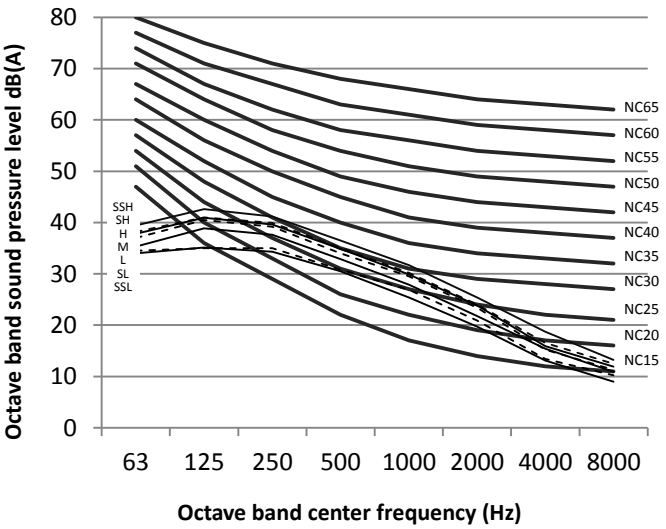
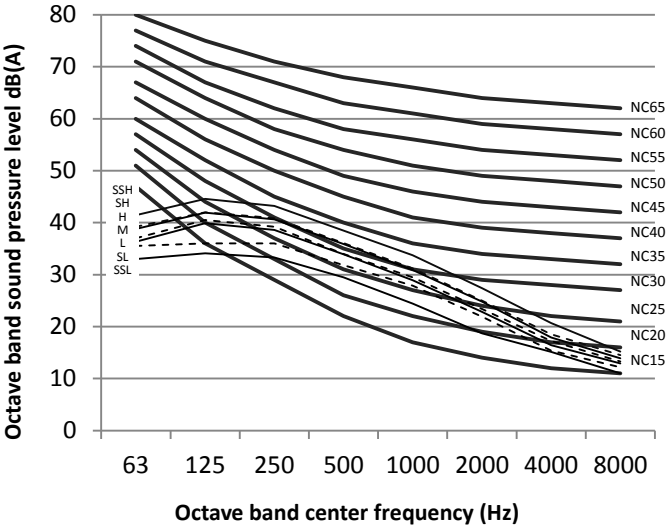
Figure 9.9: MI2-140T2DHN1 octave band levels